



USER'S INFORMATION MANUAL

Models
GMHB125
GMHB160
GMHB227
GMHB380

GMCB150
GMCB200

WARNING: If the information in this manual is not followed exactly, a fire or explosion may result causing property damage, personal injury or loss of life.

- Do not store or use gasoline or other flammable vapors and liquids in the vicinity of this or any other appliance.

- **WHAT TO DO IF YOU SMELL GAS**
 - Do not try to light any appliance.
 - Do not touch any electrical switch; do not use any phone in your building.
 - Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.
 - If you cannot reach your gas supplier, call the fire department.

- Installation and service must be performed by a qualified installer, service agency or the gas supplier.

Information and specifications outlined in this manual in effect at the time of printing of this manual. Manufacturer reserves the right to discontinue, change specifications or system design at any time without notice and without incurring any obligation, whatsoever.



Manufactured by:
ECR International Inc.
2201 Dwyer Avenue, Utica, NY 13501
Tel. 800 253 7900
www.ecrinternational.com
PN 240012364 REV. A [08/31/2018]

1 - GENERAL

1.1 GENERAL

This boiler has few USER serviceable parts. Maintenance and Service shall be completed by qualified agency.

WARNING

Fire, explosion, asphyxiation and electrical shock hazard. Improper maintenance and service could result in death or serious injury. Read this manual and understand all requirements, including use of qualified service agent where directed.

1.2 BECOME FAMILIAR WITH SYMBOLS IDENTIFYING POTENTIAL HAZARDS.



This is the safety alert symbol. Symbol alerts you to potential personal injury hazards. Obey all safety messages following this symbol to avoid possible injury or death.

DANGER

Indicates a hazardous situation which, if not avoided, WILL result in death or serious injury

WARNING

Indicates a hazardous situation which, if not avoided, could result in death or serious injury.

CAUTION

Indicates a hazardous situation which, if not avoided, could result in minor or moderate injury.

NOTICE

Used to address practices not related to personal injury.

WARNING

Following service procedures shall be performed by qualified service agent. Boiler owner shall not attempt these steps. Failure to do so could result in death or serious injury.

WARNING

Combustion chamber insulation in this product contains ceramic fiber material. Ceramic fibers can be converted to cristobalite in very high temperature applications. The International Agency for Research on Cancer (IARC) has concluded, Crystalline silica inhaled in the form of quartz or cristobalite from occupational sources is carcinogenic to humans (Group1). Avoid breathing dust and contact with skin and eyes. Use NIOSH certified dust respirator (N95). This type of respirator is based on the OSHA requirements for cristobalite at the time this document was written. Other types of respirators may be needed depending on the job site conditions. Current NIOSH recommendations can be found on the NIOSH website at <http://www.cdc.gov/niosh/homepage.html>. NIOSH approved respirators, manufacturers, and phone numbers are also listed on this website. Wear long-sleeved, loose fitting clothing, gloves, and eye protection. Apply enough water to the combustion chamber lining to prevent dust. Wash potentially contaminated clothes separately from other clothing. Rinse clothes washer thoroughly.

NIOSH stated First Aid. Eye: Irrigate immediately. Breathing: Fresh air.

Use of CO monitor is manufacturer recommended and may be requirement of local jurisdiction.

CAUTION

WHAT TO DO IF YOU SMELL GAS

- **Do not try to light any appliance.**
- **Do not touch any electrical switch; do not use any phone in your building.**
- **Immediately call your gas supplier from a neighbor's phone. Follow the gas supplier's instructions.**
- **If you cannot reach your gas supplier, call the fire department.**

FOR YOUR SAFETY READ BEFORE OPERATING



Hot Water Can Scald!

Water heated to temperature for clothes washing, dish washing and other sanitizing needs can scald and cause permanent injury.

Children, elderly, and infirm or physically handicapped persons are more likely to be permanently injured by hot water. Never leave them unattended in bathtub or shower. Never allow small children to use a hot water tap or draw their own bath.

If anyone using hot water in the building fits the above description, or if state laws or local codes require certain water temperatures at hot water taps, you must take special precautions:

- Use lowest possible temperature setting.
- Install some type of tempering device, such as an automatic mixing valve, at hot water tap or water heater. Automatic mixing valve must be selected and installed according to manufacturer's recommendations and instructions.

Water passing out of drain valves may be extremely hot. To avoid injury:

- Make sure all connections are tight.
- Direct water flow away from any person.

Water Temperature Setting	1st Degree Burn Exposure Time For An Adult	2nd and 3rd Degree Burn Exposure Time For An Adult
120° F	1 minute	5 minutes
130° F	5 seconds	30 seconds
140° F	2 seconds	5 seconds
150° F	1 second	1.5 seconds
160° F	Instantaneous	0.5 seconds

Note: Warning for Infants, Children, and the Elderly: Great care must be taken when exposing the aforementioned groups to warm or hot water as they can be badly burned in exposure times less than half of the time for an adult.

⚠ WARNING

If you do not follow these instructions exactly, a fire or explosion may result causing property damage, personal injury or loss of life.

- This appliance is equipped with an ignition device which automatically lights burner. **Do NOT try to light this burner by hand.**
- Before operating smell all around appliance area for gas. Be sure to smell next to floor because some gas is heavier than air and will settle to the floor.
- **Use only your hand to turn the gas shutoff valve.** Never use tools. If valve will not turn by hand, do not try to repair it, call a qualified service technician. Force or attempted repair may result in fire or explosion.
- **Do not use this appliance if any part has been under water.** Immediately call a qualified service technician to inspect appliance and to replace any part of control system and any gas control which has been under water.
- **Do not block the flow of combustion or ventilation air to boiler.**

1.3 WHAT TO DO SHOULD OVERHEATING OCCUR

Do not turn off or disconnect electrical supply to pumps. Shut off gas supply at location external to appliance.

1.4 WHAT TO DO IF BOILER OR ANY PART HAS BEEN UNDER WATER

Do not use boiler if any part has been under water. Immediately call a qualified service technician to inspect boiler and to replace any part of control system and any gas control which has been under water.

2 - OPERATING INSTRUCTIONS

2.1 OPERATION

Boiler is wall mounted, fan assisted room-sealed combination boiler, providing both central heating and domestic hot water depending on model purchased.

- After initial lighting, boiler will provide central heating (as required).
- Hot water is available whenever a hot tap is open (Combi models only).
- Priority is always given to hot water (Combi models only).

2.2 OPERATING INSTRUCTIONS

Stop! Read ALL Safety information above.

- Set thermostat to lowest setting.
- Turn "OFF" all electrical power to appliance.
- This appliance is equipped with an ignition device which automatically lights the burner. **Do not try to light burner by hand!**
- Turn gas shutoff valve to closed position. Handle should be perpendicular to gas pipe (at a 90° angle to gas pipe).
- Wait 5 minutes for any gas to clear. Smell for gas, including near floor. If you smell gas, **STOP!** Follow instructions on page 2: "**What To Do If You Smell Gas.**" If you do **not** smell gas, go to next step.
- Turn gas shutoff valve to the open position. Handle should be parallel to gas pipe.
- Replace front jacket panel.
- Turn "ON" electrical power to appliance.
- Set thermostat to desired setting.
- Set correct operating mode. See 2.4 below*
- If the appliance will not operate, follow instructions TO TURN OFF GAS TO APPLIANCE and call your service technician or gas supplier.


2.3 TURN OFF GAS TO APPLIANCE



- Set thermostat to lowest setting.
- Turn "OFF" all electric power to appliance if service is to be performed.
- Turn gas shutoff valve handle to closed position. Handle should be perpendicular (at a 90° angle to gas pipe).

2.4 OPERATING MODES*




A. Heat Only


SYMBOL DISPLAYED	OPERATING MODE
	HEATING ONLY



To enable the appliance in Heating only press  repeatedly and choose one Heating Only.

To disable the boiler operating modes and keep the frost protection function enabled, press  for at least 3 seconds. Just the symbol  appears on the display (the display backlighting flashes if the boiler is blocked).

B. Combi

SYMBOL DISPLAYED	OPERATING MODE
	DHW
	DHW & HEATING
	HEATING ONLY
	FROST PROTECTION




To enable the appliance in DHW - Heating or Heating only press  very short push repeatedly and choose one of three available modes.


To disable the boiler operating modes and keep the frost protection function enabled, press  for at least 3 seconds. Just the symbol  appears on the display (the display backlighting flashes if the boiler is blocked).

3 - CONTROL







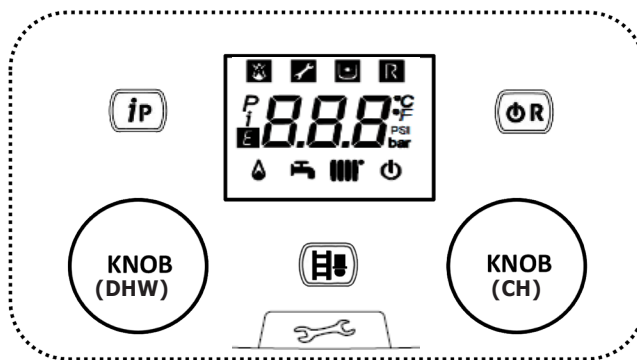






3.1 USER CONTROLS

BUTTON Explanation:

LEFT KNOB	DHW temperature adjustment (CW to increase the temperature and CCW to decrease it)
RIGHT KNOB	Heating water temperature adjustment (CW to increase the temperature and CCW to decrease it)
	Boiler operating information
	Deaeration (Long Push) Comfort function (Short Push)
	Off - Reset - Exit menu/functions




SYMBOL Explanation:

	Off: Heating and DHW disabled (only boiler frost protection is active)		Burner lit
	Ignition fault		DHW operating mode enabled
	Boiler/system water pressure low		Heating mode enabled
	Call a qualified service technician		Programming menu
	Manually resettable fault 		Boiler information menu
	Fault in progress		Set unit of measurement (SI/US)

3.2 CENTRAL HEATING SYSTEM PRESSURE

Regularly check the pressure displayed on the pressure gauge "B" is between 14.50 and 21.76 psi (1.0 - 1.5 bar), with the boiler cold.

If the pressure is less than 14.50 psi, or higher than 21.76 psi call an authorized SERVICE technician.

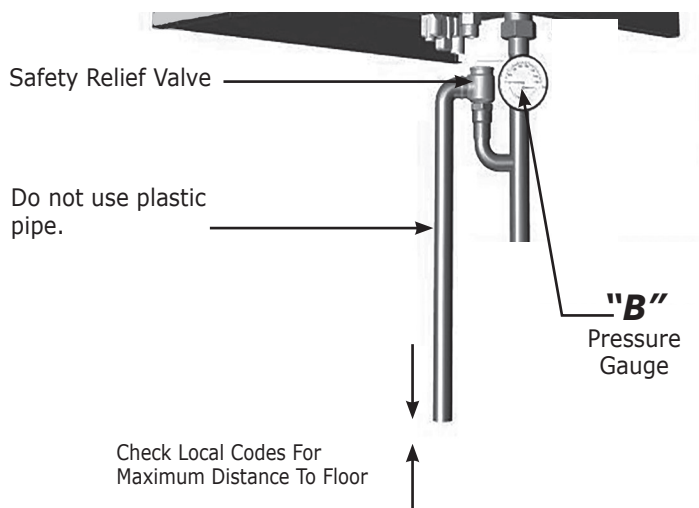


3 - CONTROL


3.3 TEMPERATURE CONTROL

Rotate appropriate control knobs to adjust CH and DHW flow temperature (if an indirect storage tank is fitted).



When burner is lit, display shows the symbol .



HEATING: while boiler is operating in heating mode, the display shows the flashing symbol  and the heating flow temperature °F / °C.

When connected to an Outdoor Temperature Sensor, Right Knob indirectly adjusts room temperature (factory setting 68°F / 20°C).


DHW: While boiler is operating in DHW mode, display shows the flashing symbol  and heating flow temperature °F / °C.

3.4 BOILER INFORMATION MENU (See Below)

Press  and hold for at least 1 second, to display the information indicated in the table. Press  to exit.

	DESCRIPTION		DESCRIPTION
00	Secondary fault internal code	09	Setpoint Central Heating (°F/°C)
01	Heating flow temperature (°F/°C)	10/11	Manufacturing information
02	Outdoor temperature (°F/°C)	12	Flue sensor temperature (°F/°C)
03	Indirect Tank DHW temperature (boiler CH only)	13	Manufacturing information
04	Domestic hot water temperature (boiler with plate exchanger)	14	Identification Open Therm communication
05	Water pressure in heating system (PSI/bar)	15	Manufacturing information
06	Heating return temperature (°F/°C)	16	Manufacturing information
07	Thermo fuse status (000/001)	17	Fan speed ("i17"x100)
08	Not used	18	Manufacturing information

3.5 SHUTTING OFF THE BOILER

To turn off the boiler, disconnect the electric power supply. In the "Off" operating mode  the boiler stays off but the electrical circuits remain powered and the frost protection function remains active.

3.6 FROST PROTECTION MODE

The electronic boiler management system includes a "frost protection" function for the heating system which, when delivery temperature falls below 41°F (5°C), lights the burner until a delivery temperature of 86°F (30°C) is reached.

This function is only operative if the boiler is electrically powered and there is gas with normal system pressure and the flue is not blocked.

3.7 COMFORT FUNCTION (Combi only)

When enabled, boiler will cycle ON as required to maintain DHW heat exchanger at operating temperature. this reduces the response time for hot water when the faucet is opened.

3 - CONTROL

3.6 ERROR MESSAGES AND RESETTING THE BOILER

E	ERROR DESCRIPTION	OPERATION	
09	Gas valve connection fault.	Call an authorized SERVICE technician	
10	Outdoor sensor fault .	Call an authorized SERVICE technician	
15	Gas valve error.	Call authorized SERVICE technician	
20	Central Heating NTC sensor fault.	Call authorized SERVICE technician	
28-29	Flue NTC heat exchanger sensor fault	Call authorized SERVICE technician	
40	Return NTC sensor fault.	Call authorized SERVICE technician	
50	Domestic Hot Water NTC sensor fault (only for heating-only model with storage boiler).	Call authorized SERVICE technician	
53	Obstruction in flue pipe.	Turn boiler off for a few seconds If this fault persists, call authorized SERVICE technician	
55	PCB not programmed.	Call authorized SERVICE technician	
83-84-85-86-87	Communication problem between boiler board and control unit. Probable short circuit on wiring.	Call authorized SERVICE technician	
98	Internal error.	Call authorized SERVICE technician	
109	Pre-circulation alarm (temporary fault).	Call authorized SERVICE technician	
110	R	Safety thermostat tripped due to over temperature (probable blocked pump or air in heating circuit).	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
118	Hydraulic pressure too low.	Call authorized SERVICE technician	
125	R	No circulation safety trip (control performed via temperature sensor).	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
128	R	Loss of flame.	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
130 - 131	Flue NTC sensor tripped due to over temperature.	Call authorized SERVICE technician	
132	Ignition Failure (Under 35 attempts)	No action required boiler will continue ignition attempt	
133	R	Ignition failure (35 attempts).	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
134	R	Gas supply valve blocked.	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
135	Internal error.	Call authorized SERVICE technician	
160	Fan fault.	Call authorized SERVICE technician	
162	Flue pressure switch (contact open)	Call authorized SERVICE technician	
317	Incorrect power supply frequency.	Incorrect power supply frequency.	
321	NTC domestic hot water sensor faulty.	Call authorized SERVICE technician	
384	R	Fault flame (parasitic flame).	Press RESET (R) button for at least 2 seconds If this fault persists, call authorized SERVICE technician
385	Input voltage too low.	Call authorized SERVICE technician	

R To RESET boiler: press the button () for at least 2 seconds

4 - MAINTENANCE

WARNING

Asphyxiation hazard. Contact qualified agency if condensate trap is not filled with water.




Perform general housekeeping and maintenance as specified below.

4.1 Continuous

- Keep boiler area free from combustible materials, gasoline and other flammable vapors and liquids.
- Keep combustion air and vent terminations (outside building) free from trash, vegetation and other items capable of blocking flow.

CHECK LIST

If a fault develops, or is suspected, call your Service Technician as soon as possible. Go through the following check list before you contact Service Agency.

- Is electricity supply on?
- Is display ON and symbols   displayed?
- Is symbol  displayed?
- Is gas supply on?
- Is main water supply turned on?
- Is system pressure correct?
- Are boiler temperature controls set high enough?
- Is room thermostat (if fitted) set high enough?
- Are radiator valves open?

4.2 Monthly

- Inspect combustion air, vent, and condensate drain piping for deterioration, leaks or sagging. Contact qualified agency, as necessary.
- Inspect system piping for leaks. Contact qualified agency, as necessary.
- Inspect condensate drain trap for sediment or blockage. Contact qualified agency if cleaning required.
- Check air vent(s) for leakage.
- Follow OPERATING INSTRUCTIONS to return to normal operation.

WARNING

Burn and scald hazard. Verify Safety Relief Valve discharge piping run to safe discharge location before conducting maintenance procedure. Contact qualified agency to correct improper piping.

4.3 Check According to Manufacturer's Instructions

Safety Relief Valve - Refer to manufacturer's instructions.

4.4 Annually or Beginning Each Heating Season

- Contact qualified agency to perform maintenance and cleaning per Installation, Operation and Maintenance manual. Inspection will include examining all flue product carrying areas, vent system, burner and heat exchanger.
- Will also include filling boiler with water if drained as part of End of Heating Season procedure.
- Condensate trap may require cleaning and refilling.

4.5 End of Heating Season, if boiler not used for domestic hot water

- Follow instructions to TURN OFF GAS TO APPLIANCE. See section 2.
- Contact qualified agency to drain heating system (if system does not use antifreeze) and condensate trap if heating system is exposed to freezing temperatures while out of service.



ECR International Inc. 2201 Dwyer Avenue, Utica, NY 13501
Tel. 800 253 7900
www.ecrinternational.com

All specifications subject to change without notice.
©2018 ECR International, Inc.